

- NOTES**
1. GENERATOR WIRES #35, #33 & #35, #36 TO BE INSTALLED TWISTED FROM ENGINES TO SOLENOID BOX.
 2. ALL WIRES TO BE ROCKBESTOS OR EQUIVALENT.
 3. SHIELDED WIRES MUST NOT PASS THROUGH JUNCTION BOXES OR CONDUITS.
 4. WIRE CODE NUMBERS TO BE LOCATED INCH FROM EACH END.
 5. ALL CONDENSER CASES TO BE GROUNDED & LEADS MUST NOT EXCEED 8 INCHES IN LENGTH.
 6. SEE DRAWING 55230 FOR INSTALLATION OF CONDUIT AND WIRES.

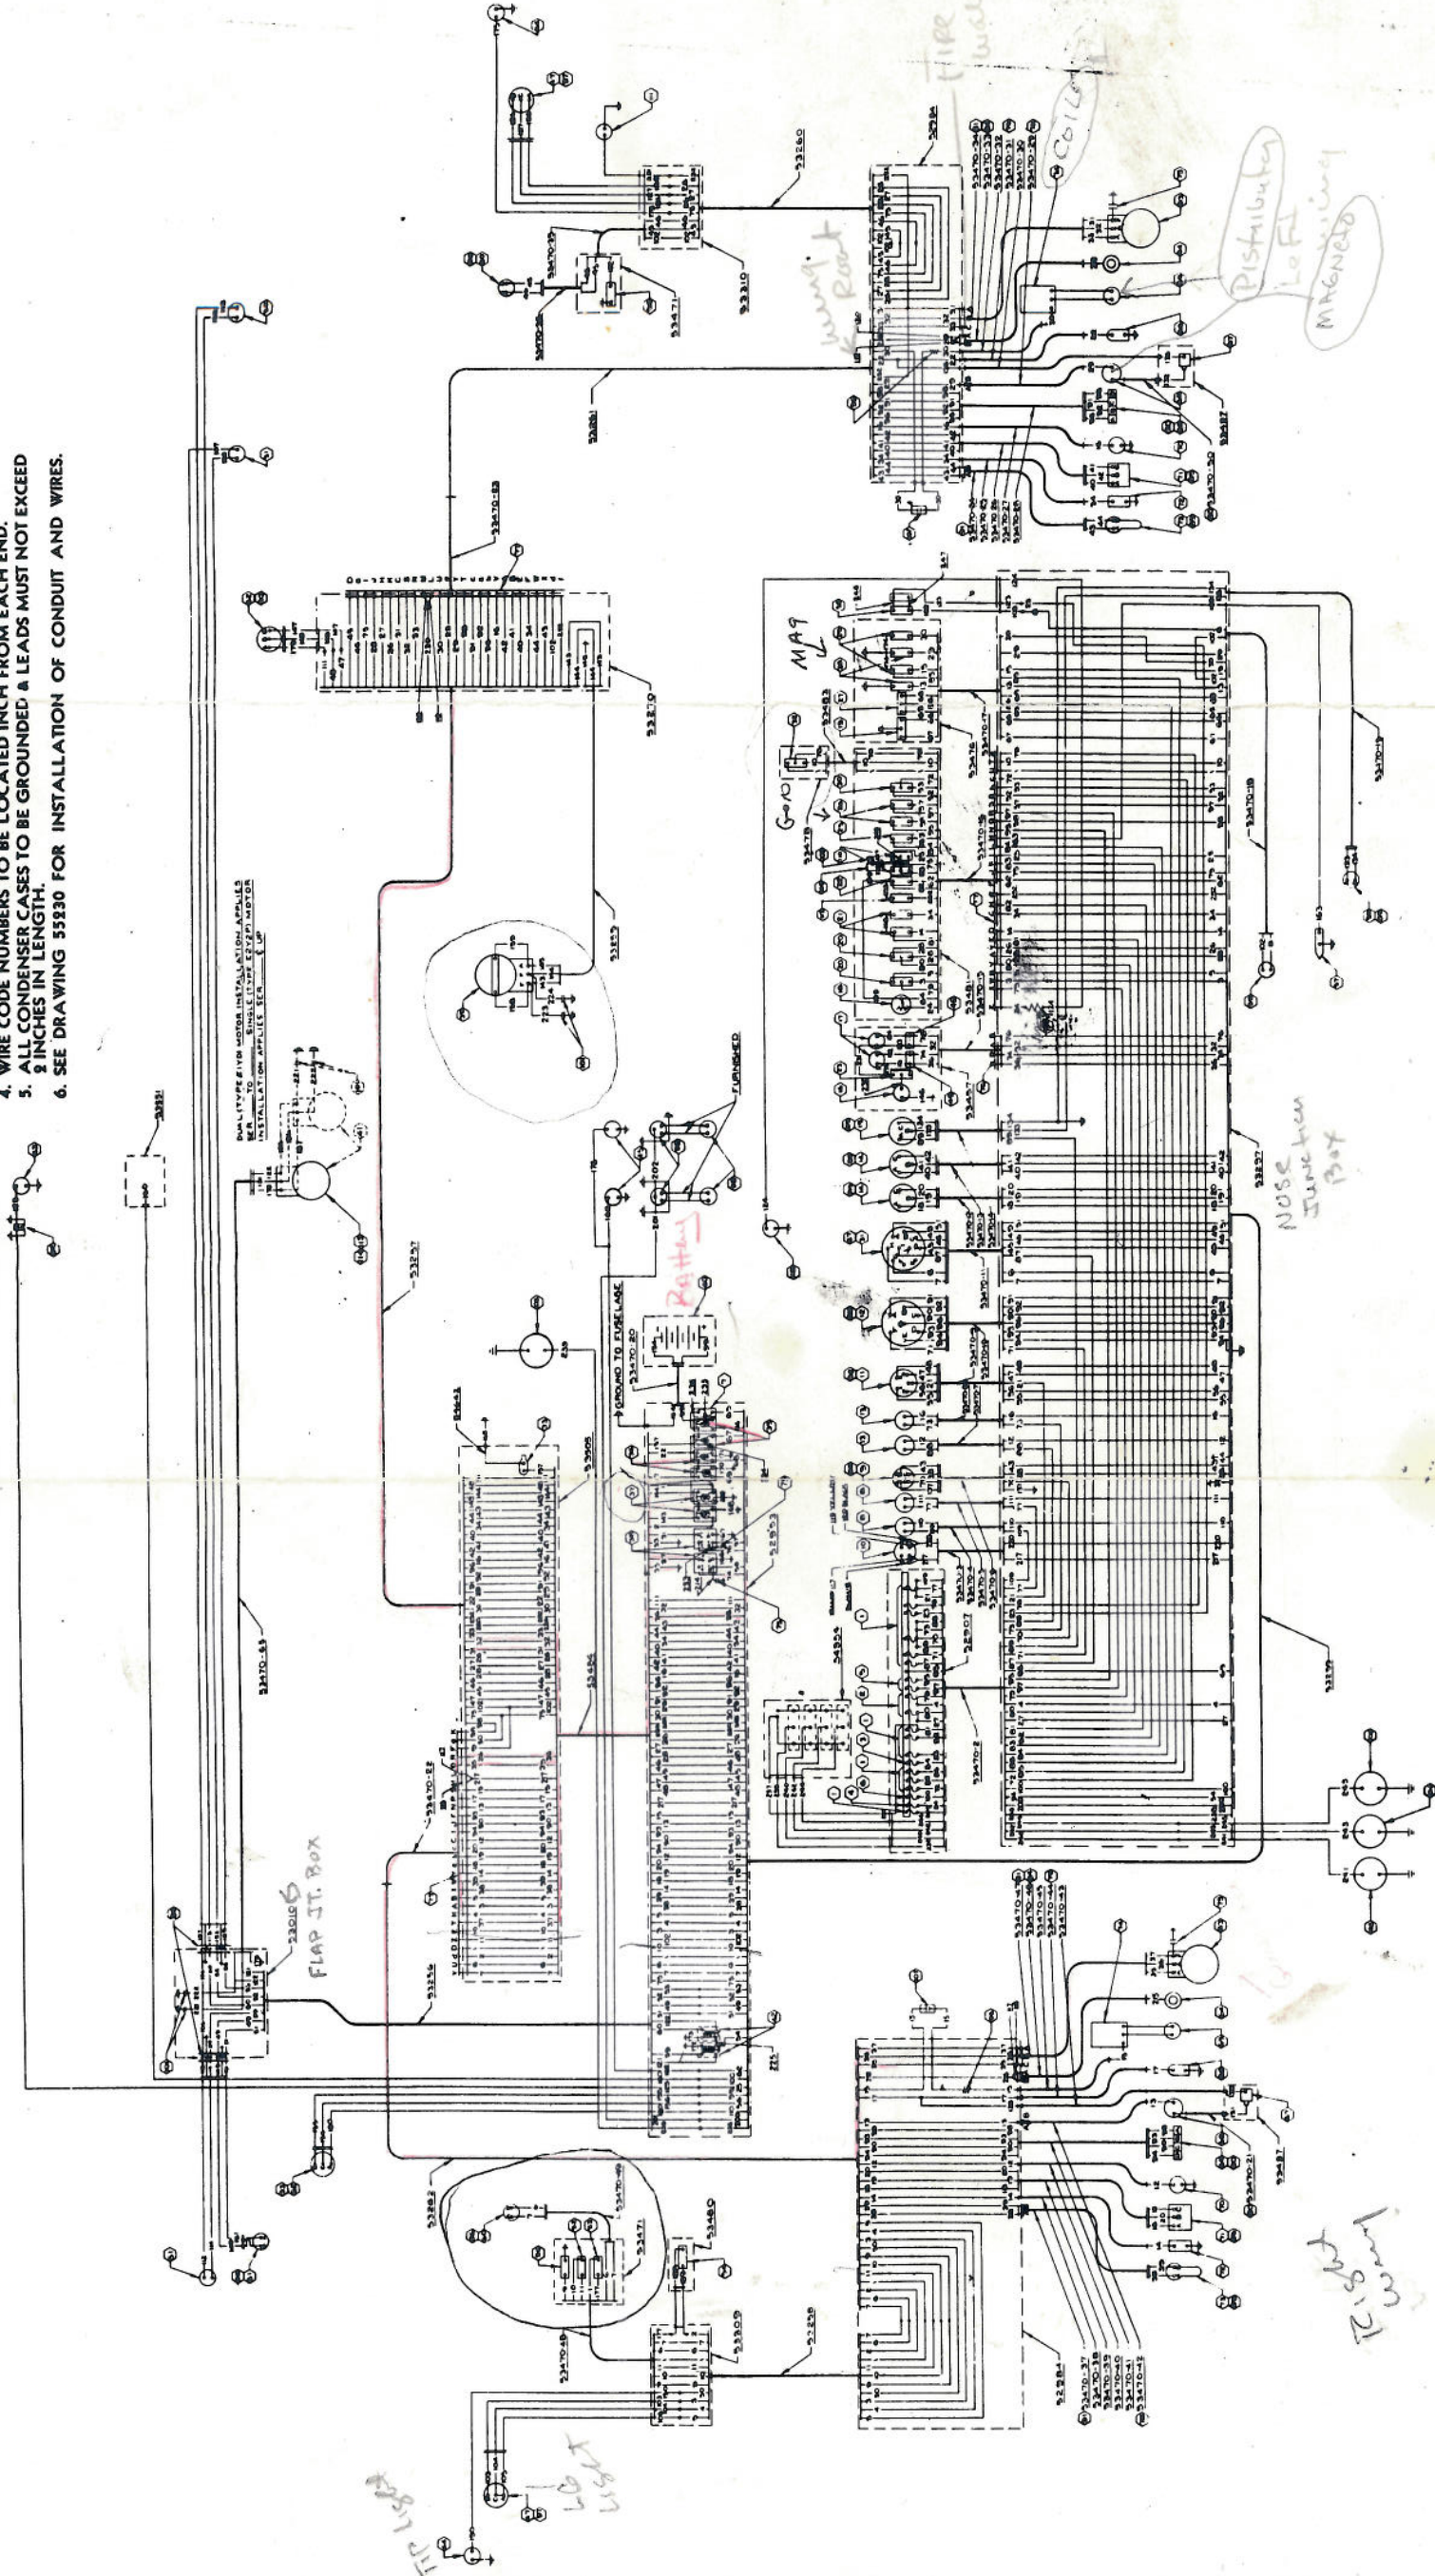


Figure 85—Wiring Diagram for AT-17, AT-17B, UC-78, UC-78B
(24 Volt—Reference Print 52975)